

# APPENDIX F

## RADON CONTROL METHODS

(Not Adopted by the State of Oregon)

### SECTION AF101 SCOPE

**AF101.1 General.** This appendix contains requirements for new construction in jurisdictions where radon-resistant construction is required.

Inclusion of this appendix by jurisdictions shall be determined through the use of locally available data or determination of Zone 1 designation in Figure AF101.

### SECTION AF102 DEFINITIONS

**AF102.1 General.** For the purpose of these requirements, the terms used shall be defined as follows:

**SUBSLAB DEPRESSURIZATION SYSTEM (Passive).** A system designed to achieve lower sub-slab air pressure relative to indoor air pressure by use of a vent pipe routed through the conditioned space of a building and connecting the sub-slab area with outdoor air, thereby relying on the convective flow of air upward in the vent to draw air from beneath the slab.

**SUBSLAB DEPRESSURIZATION SYSTEM (Active).** A system designed to achieve lower sub-slab air pressure relative to indoor air pressure by use of a fan-powered vent drawing air from beneath the slab.

**DRAIN TILE LOOP.** A continuous length of drain tile or perforated pipe extending around all or part of the internal or external perimeter of a basement or crawl space footing.

**RADON GAS.** A naturally-occurring, chemically inert, radioactive gas that is not detectable by human senses. As a gas, it can move readily through particles of soil and rock and can accumulate under the slabs and foundations of homes where it can easily enter into the living space through construction cracks and openings.

**SOIL-GAS-RETARDER.** A continuous membrane of 6-mil (0.15 mm) polyethylene or other equivalent material used to retard the flow of soil gases into a building.

**SUBMEMBRANE DEPRESSURIZATION SYSTEM.** A system designed to achieve lower-sub-membrane air pressure relative to crawl space air pressure by use of a vent drawing air from beneath the soil-gas-retarder membrane.

### SECTION AF103 REQUIREMENTS

**AF103.1 General.** The following construction techniques are intended to resist radon entry and prepare the building for post-construction radon mitigation, if necessary (see Figure AF102). These techniques are required in areas where designated by the jurisdiction.

**AF103.2 Subfloor preparation.** A layer of gas-permeable material shall be placed under all concrete slabs and other floor systems that directly contact the ground and are within the walls of the living spaces of the building, to facilitate future

installation of a sub-slab depressurization system, if needed. The gas-permeable layer shall consist of one of the following:

1. A uniform layer of clean aggregate, a minimum of 4 inches (102 mm) thick. The aggregate shall consist of material that will pass through a 2-inch (51 mm) sieve and be retained by a 1/4-inch (6.4 mm) sieve.
2. A uniform layer of sand (native or fill), a minimum of 4 inches (102 mm) thick, overlain by a layer or strips of geotextile drainage matting designed to allow the lateral flow of soil gases.
3. Other materials, systems or floor designs with demonstrated capability to permit depressurization across the entire sub-floor area.

**AF103.3 Soil-gas-retarder.** A minimum 6-mil (0.15 mm) [or 3-mil (0.075 mm) cross-laminated] polyethylene or equivalent flexible sheeting material shall be placed on top of the gas-permeable layer prior to casting the slab or placing the floor assembly to serve as a soil-gas-retarder by bridging any cracks that develop in the slab or floor assembly and to prevent concrete from entering the void spaces in the aggregate base material. The sheeting shall cover the entire floor area with separate sections of sheeting lapped at least 12 inches (305 mm). The sheeting shall fit closely around any pipe, wire or other penetrations of the material. All punctures or tears in the material shall be sealed or covered with additional sheeting.

**AF103.4 Entry routes.** Potential radon entry routes shall be closed in accordance with Sections AF103.4.1 through AF103.4.10.

**AF103.4.1 Floor openings.** Openings around bathtubs, showers, water closets, pipes, wires or other objects that penetrate concrete slabs or other floor assemblies shall be filled with a polyurethane caulk or equivalent sealant applied in accordance with the manufacturer's recommendations.

**AF103.4.2 Concrete joints.** All control joints, isolation joints, construction joints and any other joints in concrete slabs or between slabs and foundation walls shall be sealed with a caulk or sealant. Gaps and joints shall be cleared of loose material and filled with polyurethane caulk or other elastomeric sealant applied in accordance with the manufacturer's recommendations.

**AF103.4.3 Condensate drains.** Condensate drains shall be trapped or routed through nonperforated pipe to daylight.

**AF103.4.4 Sumps.** Sump pits open to soil or serving as the termination point for sub-slab or exterior drain tile loops shall be covered with a gasketed or otherwise sealed lid. Sumps used as the suction point in a sub-slab depressurization system shall have a lid designed to accommodate the vent pipe. Sumps used as a floor drain shall have a lid equipped with a trapped inlet.

**AF103.4.5 Foundation walls.** Hollow block masonry foundation walls shall be constructed with either a continuous course of solid masonry, one course of masonry grouted solid, or a solid concrete beam at or above finished ground surface to prevent passage of air from the interior of the wall into the living space. Where a brick veneer or other masonry ledge is installed, the course immediately below that ledge shall be sealed. Joints, cracks or other openings around all penetrations of both exterior and interior surfaces of masonry block or wood foundation walls below the ground surface shall be filled with polyurethane caulk or equivalent sealant. Penetrations of concrete walls shall be filled.

**AF103.4.6 Dampproofing.** The exterior surfaces of portions of concrete and masonry block walls below the ground surface shall be dampproofed in accordance with Section R406 of this code.

**AF103.4.7 Air-handling units.** Air-handling units in crawl spaces shall be sealed to prevent air from being drawn into the unit.

**Exception:** Units with gasketed seams or units that are otherwise sealed by the manufacturer to prevent leakage.

**AF103.4.8 Ducts.** Ductwork passing through or beneath a slab shall be of seamless material unless the air-handling system is designed to maintain continuous positive pressure within such ducting. Joints in such ductwork shall be sealed to prevent air leakage.

Ductwork located in crawl spaces shall have all seams and joints sealed by closure systems in accordance with Section M1601.3.1.

**AF103.4.9 Crawl space floors.** Openings around all penetrations through floors above crawl spaces shall be caulked or otherwise filled to prevent air leakage.

**AF103.4.10 Crawl space access.** Access doors and other openings or penetrations between basements and adjoining crawl spaces shall be closed, gasketed or otherwise filled to prevent air leakage.

**AF103.5 Passive submembrane depressurization system.** In buildings with crawl space foundations, the following components of a passive sub-membrane depressurization system shall be installed during construction.

**Exception:** Buildings in which an approved mechanical crawl space ventilation system or other equivalent system is installed.

**AF103.5.1 Ventilation.** Crawl spaces shall be provided with vents to the exterior of the building. The minimum net area of ventilation openings shall comply with Section R408.1 of this code.

**AF103.5.2 Soil-gas-retarder.** The soil in crawl spaces shall be covered with a continuous layer of minimum 6-mil (0.15 mm) polyethylene soil-gas-retarder. The ground cover shall be lapped a minimum of 12 inches (305 mm) at joints and shall extend to all foundation walls enclosing the crawl space area.

**AF103.5.3 Vent pipe.** A plumbing tee or other approved connection shall be inserted horizontally beneath the sheeting and connected to a 3- or 4-inch-diameter (76 mm or 102

mm) fitting with a vertical vent pipe installed through the sheeting. The vent pipe shall be extended up through the building floors, terminate at least 12 inches (305 mm) above the roof in a location at least 10 feet (3048 mm) away from any window or other opening into the conditioned spaces of the building that is less than 2 feet (610 mm) below the exhaust point, and 10 feet (3048 mm) from any window or other opening in adjoining or adjacent buildings.

**AF103.6 Passive subslab depressurization system.** In basement or slab-on-grade buildings, the following components of a passive sub-slab depressurization system shall be installed during construction.

**AF103.6.1 Vent pipe.** A minimum 3-inch-diameter (76 mm) ABS, PVC or equivalent gas-tight pipe shall be embedded vertically into the sub-slab aggregate or other permeable material before the slab is cast. A "T" fitting or equivalent method shall be used to ensure that the pipe opening remains within the sub-slab permeable material. Alternatively, the 3-inch (76 mm) pipe shall be inserted directly into an interior perimeter drain tile loop or through a sealed sump cover where the sump is exposed to the sub-slab aggregate or connected to it through a drainage system.

The pipe shall be extended up through the building floors, terminate at least 12 inches (305 mm) above the surface of the roof in a location at least 10 feet (3048 mm) away from any window or other opening into the conditioned spaces of the building that is less than 2 feet (610 mm) below the exhaust point, and 10 feet (3048 mm) from any window or other opening in adjoining or adjacent buildings.

**AF103.6.2 Multiple vent pipes.** In buildings where interior footings or other barriers separate the sub-slab aggregate or other gas-permeable material, each area shall be fitted with an individual vent pipe. Vent pipes shall connect to a single vent that terminates above the roof or each individual vent pipe shall terminate separately above the roof.

**AF103.7 Vent pipe drainage.** All components of the radon vent pipe system shall be installed to provide positive drainage to the ground beneath the slab or soil-gas-retarder.

**AF103.8 Vent pipe accessibility.** Radon vent pipes shall be accessible for future fan installation through an attic or other area outside the habitable space.

**Exception:** The radon vent pipe need not be accessible in an attic space where an approved roof-top electrical supply is provided for future use.


**AF103.9 Vent pipe identification.** All exposed and visible interior radon vent pipes shall be identified with at least one label on each floor and in accessible attics. The label shall read: "Radon Reduction System."

**AF103.10 Combination foundations.** Combination basement/crawl space or slab-on-grade/crawl space foundations shall have separate radon vent pipes installed in each type of foundation area. Each radon vent pipe shall terminate above the roof or shall be connected to a single vent that terminates above the roof.

**AF103.11 Building depressurization.** Joints in air ducts and plenums in unconditioned spaces shall meet the requirements of Section M1601. Thermal envelope air infiltration requirements shall comply with the energy conservation provisions

in Chapter 11. Firestopping shall meet the requirements contained in Section R602.8.

**AF103.12 Power source.** To provide for future installation of an active sub-membrane or sub-slab depressurization system, an electrical circuit terminated in an approved box shall be installed during construction in the attic or other anticipated location of vent pipe fans. An electrical supply shall also be accessible in anticipated locations of system failure alarms.

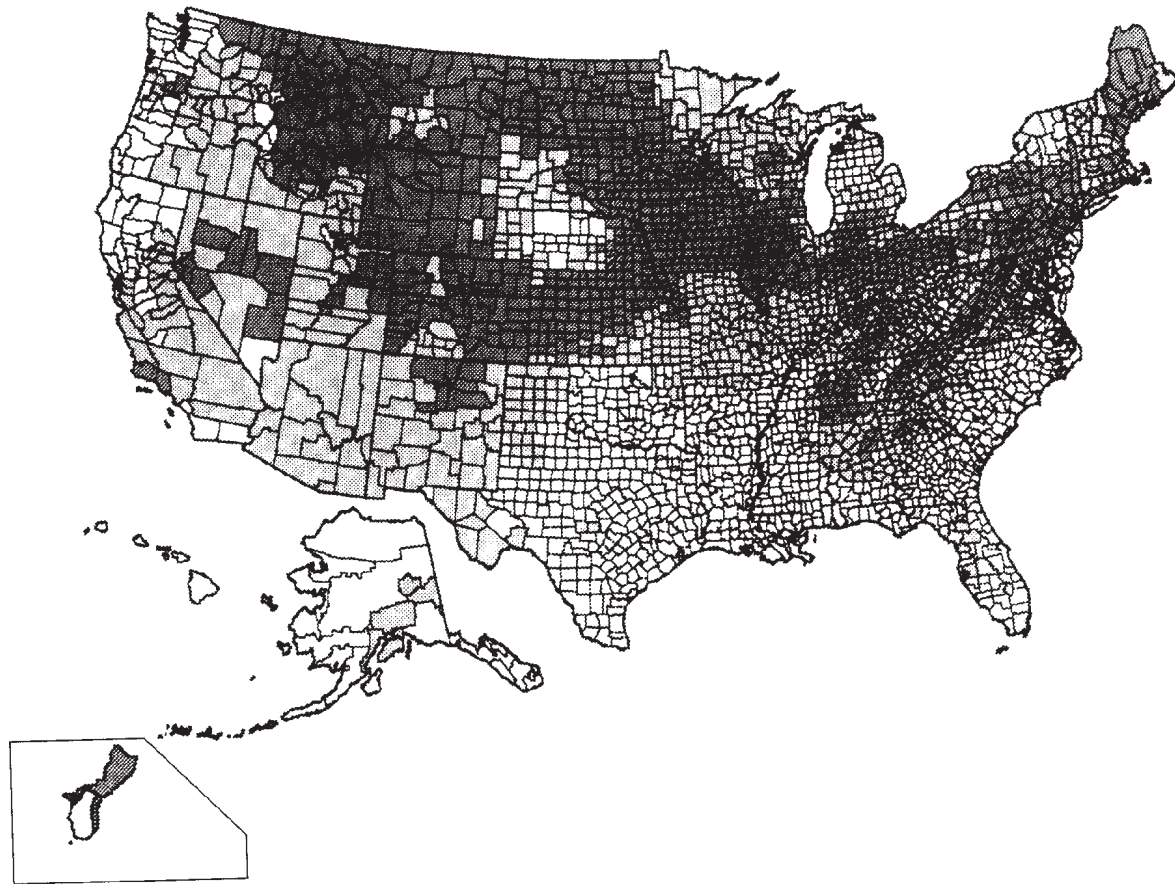

LEGEND

- ZONE 1 HIGH POTENTIAL (GREATER THAN 4 pCi/L<sup>a</sup>)
- ZONE 2 MODERATE POTENTIAL (FROM 2 TO 4 pCi/L)
- ZONE 3 LOW POTENTIAL (LESS THAN 2 pCi/L)

a.pCi/L standard for picocuries per liter of radon gas. EPA recommends that all homes that measure 4 pCi/L and greater be mitigated.

The United States Environmental Protection Agency and the United States Geological Survey have evaluated the radon potential in the United States and have developed a map of radon zones designed to assist building officials in deciding whether radon-resistant features are applicable in new construction.

The map assigns each of the 3,141 counties in the United States to one of three zones based on radon potential. Each zone designation reflects the average short-term radon measurement that can be expected to be measured in a building without the implementation of radon control methods. The radon zone designation of highest priority is Zone 1. Table 1 of this appendix lists the Zone 1 counties illustrated on the map. More detailed information can be obtained from state-specific booklets (EPA-402-R-93-021 through 070) available through State Radon Offices or from U.S. EPA Regional Offices.

**TABLE AF101(1)  
HIGH RADON POTENTIAL (ZONE 1) COUNTIES<sup>a</sup>**

<b>ALABAMA</b>	Otero	Cass	Blackford		Scott	York
Calhoun	Ouray	Champaign	Boone	<b>KANSAS</b>	Sheridan	
Clay	Park	Coles	Carroll	Atchison	Sherman	<b>MARYLAND</b>
Cleburne	Phillips	De Kalb	Cass	Barton	Smith	Baltimore
Colbert	Pitkin	De Witt	Clark	Brown	Stanton	Calvert
Coosa	Prowers	Douglas	Clinton	Cheyenne	Thomas	Carroll
Franklin	Pueblo	Edgar	De Kalb	Clay	Trego	Frederick
Jackson	Rio Blanco	Ford	Decatur	Cloud	Wallace	Harford
Lauderdale	San Miguel	Fulton	Delaware	Decatur	Washington	Howard
Lawrence	Summit	Greene	Elkhart	Dickinson	Wichita	Montgomery
Limestone	Teller	Grundy	Fayette	Douglas	Wyandotte	Washington
Madison	Washington	Hancock	Fountain	Ellis		
Morgan	Weld	Henderson	Fulton	Ellsworth	<b>KENTUCKY</b>	<b>MASS.</b>
Talladega	Yuma	Henry	Grant	Finney	Adair	Essex
		Iroquois	Hamilton	Ford	Allen	Middlesex
		Jersey	Hancock	Geary	Barren	Worcester
<b>CALIFORNIA</b>	<b>CONNECTI-</b>	Jo Daviess	Harrison	Gove	Bourbon	
Santa Barbara	<b>CUT</b>	Kane	Hendricks	Graham	Boyle	<b>MICHIGAN</b>
Ventura	Fairfield	Kendall	Henry	Grant	Bullitt	Branch
	Middlesex	Knox	Howard	Gray	Casey	Calhoun
<b>COLORADO</b>	New Haven	La Salle	Huntington	Greeley	Clark	Cass
Adams	New London	Lee	Jay	Hamilton	Cumberland	Hillsdale
Arapahoe		Livingston	Jennings	Haskell	Fayette	Jackson
Baca	<b>GEORGIA</b>	Logan	Johnson	Hodgeman	Franklin	Kalamazoo
Bent	Cobb	Macon	Kosciusko	Jackson	Green	Lenawee
Boulder	De Kalb	Marshall	Lagrange	Jewell	Harrison	St. Joseph
Chaffee	Fulton	Mason	Lawrence	Johnson	Hart	Washtenaw
Cheyenne	Gwinnett	McDonough	Madison	Kearny	Jefferson	
Clear Creek		McLean	Marion	Kingman	Jessamine	<b>MINNESOTA</b>
Crowley	<b>IDAHO</b>	Menard	Marshall	Kiowa	Lincoln	Becker
Custer	Benewah	Mercer	Miami	Lane	Marion	Big Stone
Delta	Blaine	Morgan	Monroe	Leavenworth	Mercer	Blue Earth
Denver	Boise	Moultrie	Montgomery	Lincoln	Metcalfe	Brown
Dolores	Bonner	Ogle	Noble	Logan	Monroe	Carver
Douglas	Boundary	Peoria	Orange	Marion	Nelson	Chippewa
El Paso	Butte	Piatt	Putnam	Marshall	Pendleton	Clay
Elbert	Camas	Pike	Randolph	McPherson	Pulaski	Cottonwood
Fremont	Clark	Putnam	Rush	Meade	Robertson	Dakota
Garfield	Clearwater	Rock Island	Scott	Mitchell	Russell	Dodge
Gilpin	Custer	Sangamon	Shelby	Nemaha	Scott	Douglas
Grand	Elmore	Schuyler	Steuben	Ness	Taylor	Faribault
Gunnison	Fremont	Scott	St. Joseph	Norton	Warren	Fillmore
Huerfano	Gooding	Stark	Tippecanoe	Osborne	Woodford	Freeborn
Jackson	Idaho	Stephenson	Tipton	Ottawa		Goodhue
Jefferson	Kootenai	Tazewell	Union	Pawnee	<b>MAINE</b>	Grant
Kiowa	Latah	Vermilion	Vermillion	Phillips	Androscoggin	Hennepin
Kit Carson	Lemhi	Warren	Wabash	Pottawatomie	Aroostook	Houston
Lake	Shoshone	Whiteside	Warren	Pratt	Cumberland	Hubbard
Larimer	Valley	Winnebago	Washington	Rawlins	Franklin	Jackson
Las Animas		Woodford	Wayne	Republic	Hancock	Kanabec
Lincoln	<b>ILLINOIS</b>		Wells	Rice	Kennebec	Kandiyohi
Logan	Adams	<b>INDIANA</b>	White	Riley	Lincoln	Kittson
Mesa	Boone	Adams	Whitley	Rooks	Oxford	Lac Qui Parle
Moffat	Brown	Allen		Rush	Penobscot	Le Sueur
Montezuma	Bureau	Bartholomew	<b>IOWA</b>	Russell	Piscataquis	Lincoln
Montrose	Calhoun	Benton	All Counties	Saline	Somerset	Lyons
Morgan	Carroll					

a. EPA recommends that this county listing be supplemented with other available State and local data to further understand the radon potential of Zone 1 area.

(continued)

**APPENDIX F**

Mahnomen	Pope	Todd	Buchanan	Carbon	Hill	Powder River
Marshall	Ramsey	Traverse	Cass	Carter	Jefferson	Powell
Martin	Red Lake	Wabasha	Clay	Cascade	Judith Basin	Prairie
McLeod	Redwood	Wadena	Clinton	Chouteau	Lake	Ravalli
Meeker	Renville	Waseca	Holt	Custer	Lewis and Clark	Richland
Mower	Rice	Washington	Iron	Daniels	Liberty	Roosevelt
Murray	Rock	Watonwan	Jackson	Dawson	Lincoln	Rosebud
Nicollet	Roseau	Wilkin	Nodaway	Deer Lodge	Madison	Sanders
Nobles	Scott	Winona	Platte	Fallon	McCone	Sheridan
Norman	Sherburne	Wright		Fergus	Meagher	Silver Bow
Olmsted	Sibley	Yellow Medicine	<b>MONTANA</b>	Flathead	Mineral	Stillwater
Otter Tail	Stearns		Beaverhead	Gallatin	Missoula	Teton
Pennington	Steele	<b>MISSOURI</b>	Big Horn	Garfield	Park	Toole
Pipestone	Stevens	Andrew	Blaine	Glacier	Phillips	Valley
Polk	Swift	Atchison	Broadwater	Granite	Pondera	Wibaux

a. EPA recommends that this county listing be supplemented with other available State and local data to further understand the radon potential of Zone 1 area.

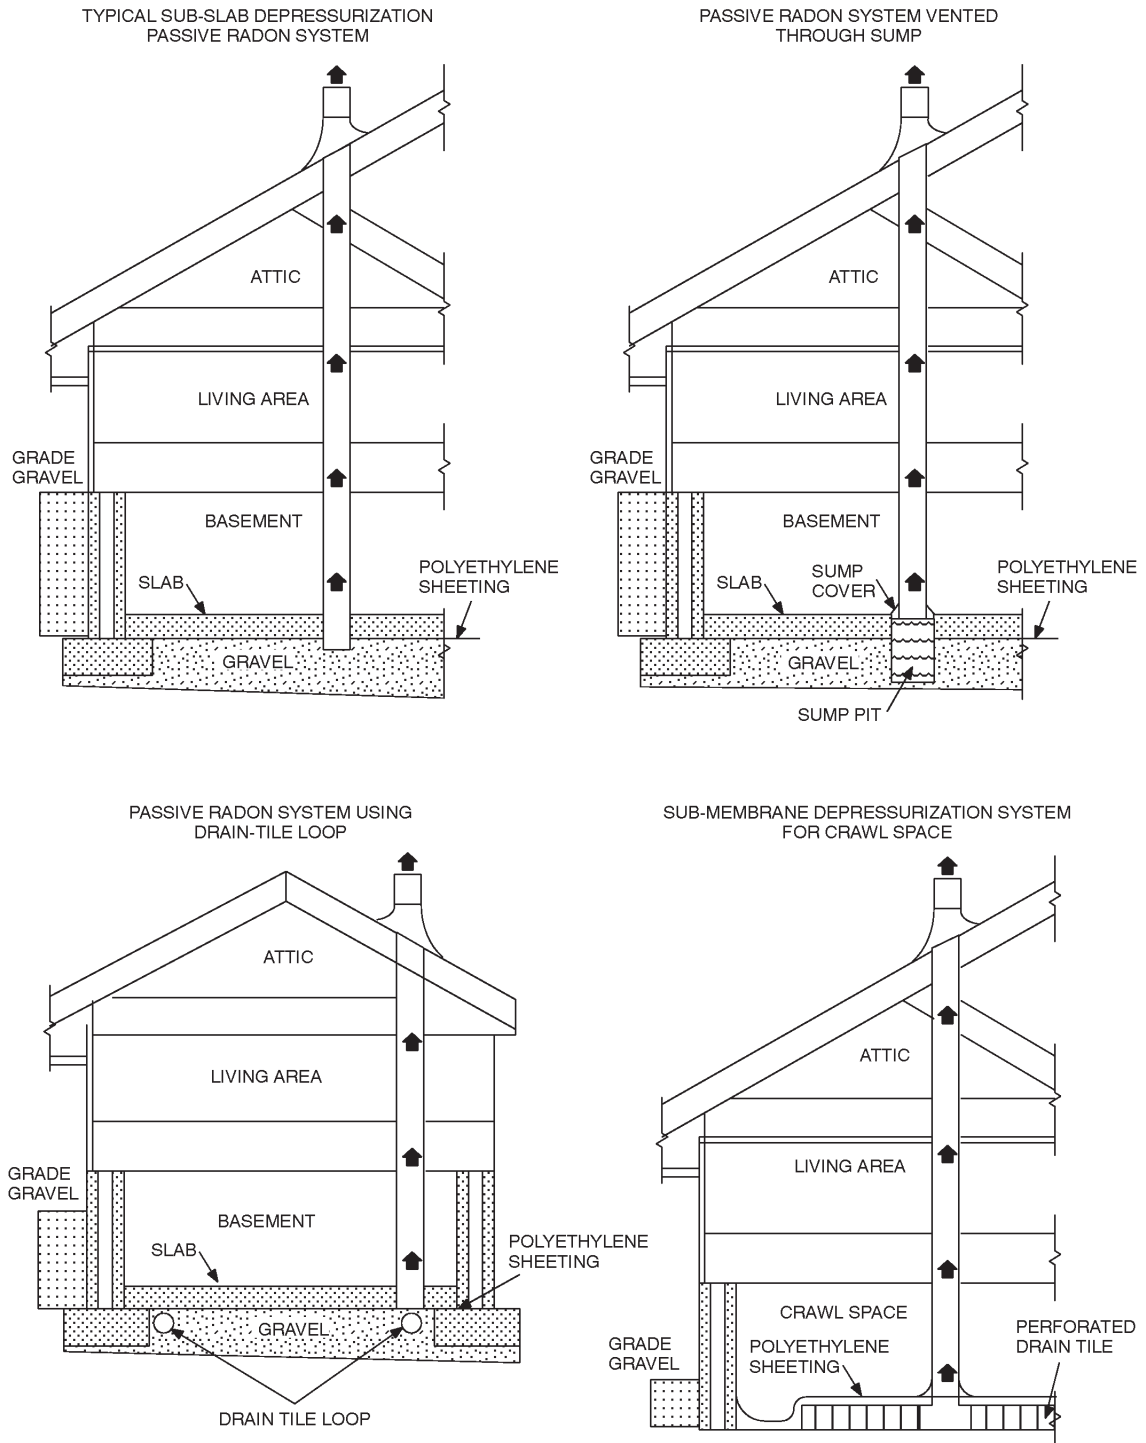


FIGURE AF102  
 RADON-RESISTANT CONSTRUCTION DETAILS FOR FOUR FOUNDATION TYPES

